


Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
01.05.2026	DINDIGUL	Dinamalar	Near Velliyantai Bus Stop Water pipe broke and water is being wasted

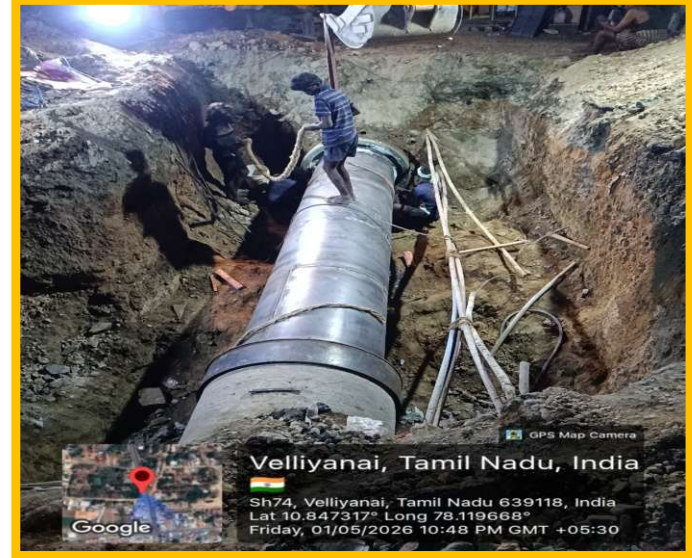

900 mm PSC pipeline leak works attended and rectified and water supply effected on 02.05.2026 under Dindigul CWSS in **Dindigul District**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
01.05.2026	ERODE	Dinakaran	No water supply due to a break in the main pipe



300 mm MS pipeline & 250mm PSC pipe leak was attended and water supply effected on 30.04.2026 under CWSS to Chennai in Erode district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
01.05.2026	VELLORE	Dinamalar	Water pipeline leak in Vellore fort road



600 mm DI pipeline leak was attended and water supply effected on 02.05.2026 under **Vellore CWSS in Vellore district**

Action taken on the Water supply issues reported



Date	District	Name of the Newspaper	Issues published
02.05.2026	Thiruvannamalai	Dinamalar	Combined water supply scheme pipe damaged



75 mm PVC pipeline leak was attended and water supply effected on 03.05.2026 under Keelpennathur CWSS in Thiruvannamalai district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
05.05.2026	DINDIGUL	Dinakaran	Damaged pipeline causing leakage near Eriyodu

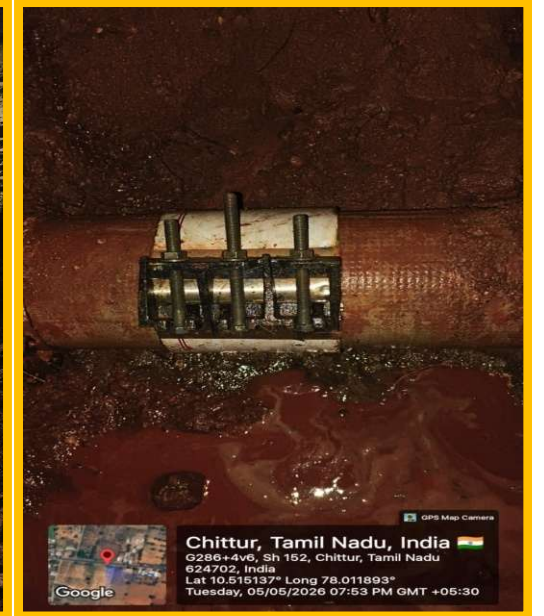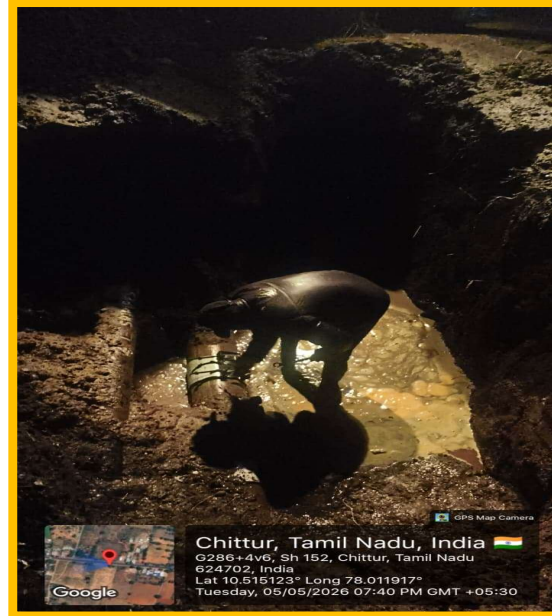

250 mm AC pipeline leak was attended and water supply effected on 06.05.2026 under **Dindigul CWSS in Dindigul district**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
06.05.2026	KRISHNAGIRI	Kalaikathir	People are protesting with empty bottles, demanding drinking water



In Appukottai habitation of Vilangudi Panchayat, Illegal connections in 110 mm HDPE pipe had been removed by TWAD officials along with Local body Administration , under Hogenakkal Water Supply and Fluorosis Mitigation Project in Krishnagiri & Dharmapuri district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
06.05.2026	TENKASI	DINAMALAR	Newly laid road turns into potholes due to pipe burst; motorists fear accidents



Damaged 63 mm PVC was rectified and water supply effected on 06.05.2026 under CWSS to Shencottai Municipality 4TP's and 47 wayside Habitations in Tenkasi district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
07.05.2026	POLLACHI	Dinakaran	Water wasted due to damaged pipeline by setting fire to dry bushes ; people in distress



Latitude: 10.692095
 Longitude: 77.048137
 Elevation: 322.66±4.34 m
 Accuracy: 18.69 m
 Time: 06-05-2026 13:12
 Note: வடுகபாளையம் தொகுதியில் சூலைஸ்வரண்பட்டி

140mm PVC pipe line leak was rectified on 6.05.2026 under CWSS to Suleeswaranpatti, in Coimbatore district

Action taken on the Water supply issues reported


Date	District	Name of the Newspaper	Issues published
07.05.2026	POLLACHI	Dinamalar	Machine hole damaged ; Risk of road accidents



Damaged machine hole cover at Pollachi –Palladam road (Mahalingam junction) was replaced on 6.5.2026 for Pollachi UGSS in Coimbatore district

Action taken on the Water supply issues reported


Date	District	Name of the Newspaper	Issues published
08.05.2026	NAGAPATTINAM	HINDU TAMZHH	Kollidam water pipe damaged in 5 places, raising the risk of water scarcity

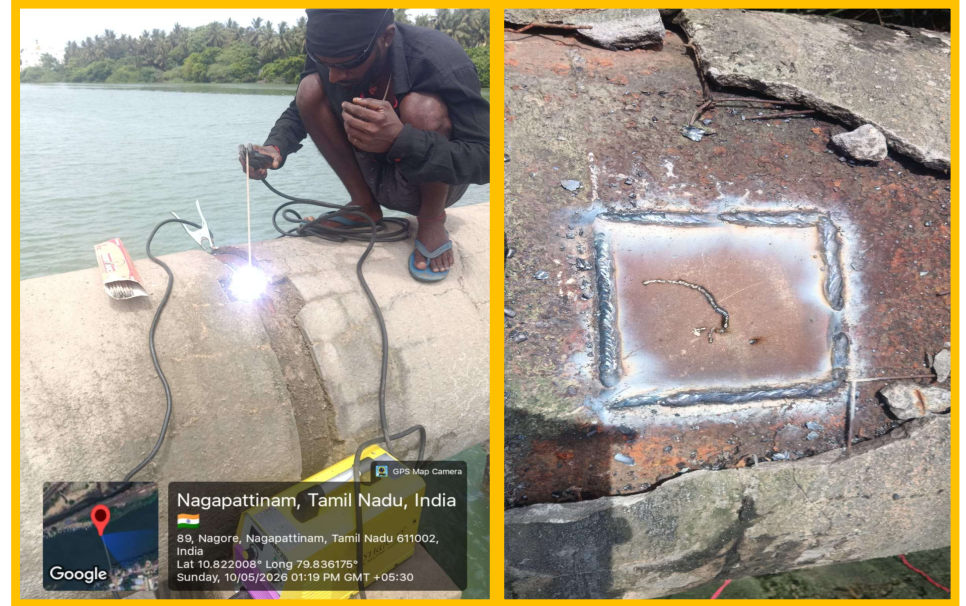

700mm PSC pipe line leaks were rectified and water supply effected on 10.05.2026 under **Nagapattinam CWSS** in **Nagapattinam district**

Action taken on the Water supply issues reported


Date	District	Name of the Newspaper	Issues published
09.05.2026	THENI	DHINAMALAR	Drinking water wasted due to a broken pipe.

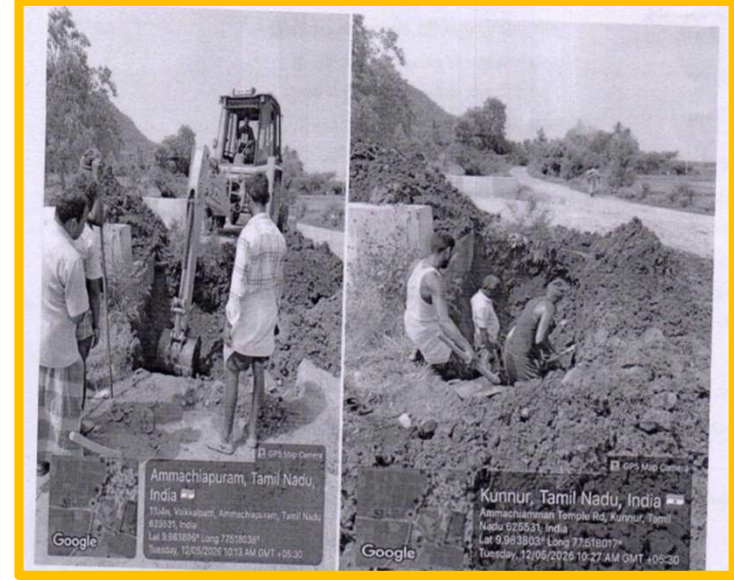

300 mm AC pipeline leak was rectified and water supply effected on 12.05.2026 under **CWSS to palakombai & 48 other habitation in Theni district.**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
09.05.2026	THIRUVARUR	DINAKARAN	The drinking water shortage must be resolved

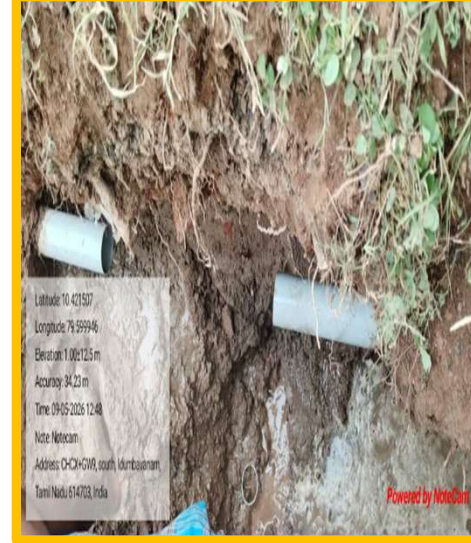


90mm PVC pipe line leak was rectified and water supply effected on 09.05.2026 under **CWSS to vedaranyam in Thiruvavarur district.**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
10.05.2026	Dindigul	DINA THANTHI	Drinking water wasted due to a broken pipe

குழாய் உடைந்து வீணாகும் குடிநீர்
 ளரியோடு, மே.10-
 ளரியோட்டில், கோவிலூர் செல்லும் சாலையில் காவிரிக்
 கூட்டு குடிநீர் குழாய் செல்கிறது. இந்த குழாயில் நேற்று
 திடீரென உடைப்பு ஏற்பட்டு, குடிநீர் சாலையில் வீணாக
 ஓடியது. இதே குழாயில் அடிக்கடி உடைப்பு ஏற்பட்டு, குடிநீர்
 வீணாகி வருவதால், அந்த வழியாக செல்லும் திண்டுக்கல்-
 கரூர் சாலை சேதமடைந்து குண்டும், குழியுமாக மாறியுள்ளது.
 வீணாகும் குடிநீர் சாலையில் உள்ள பள்ளத்தில் தேங்கியுள்
 ளது. இதனால் சாலையில் பள்ளங்கள் இருப்பது தெரியாமல்
 வாகன ஓட்டிகள் விபத்தில் சிக்கி வருகின்றனர். எனவே
 குழாய் உடைப்பை சரிசெய்து, குடிநீர் வீணாவதை தடுக்க
 வேண்டும். அத்துடன் சேதமடைந்த சாலையை சீரமைக்க
 வேண்டும் என்று பொதுமக்கள் கோரிக்கை விடுத்துள்ளனர்.

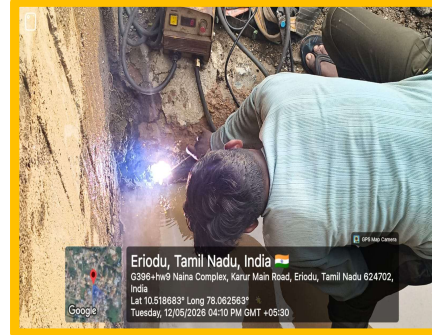

450mm PSC pipe line leak was rectified and water supply effected on 12.05.2026 under CWSS to Dindigul Corporation in 7 Town Panchayat & 636 Rural Habitation in Dindigul district.

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
10.05.2026	DHARMAPURI	DINAKARAN	Drinking water has been going to waste on the road for a month



500mm DI pipe line leak was rectified and water supply effected on 10.05.2026 under **Hogenakkal Water Supply and Fluorosis Mitigation Project** in Dharmapuri District.

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
12.05.2026	KARUR	DINAKARAN	A leak in the Kaveri CWSS pipeline caused water wastage



700 mm PSC pipeline leak works was rectified and water supply effected under **CWSS to 674 habitation in Manaparai and Marungapuri union in karur district**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
14.05.2026	TENKASI	DINAMALAR	People are suffering due to damaged roads caused by breakage of drinking water pipe.



450mm PSC pipe line leak was rectified and water supply effected on 14.05.2026 under CWSS to Sengottai Municipality 4TP's and 47 wayside Habitations in Tenkasi district.

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
15.05.2026	Dindigul	HINDU TAMIZH	Drinking water was wasted due to damage of giant pipeline burst on the road



900mm PSC pipe line leak was rectified and water supply effected on 15.05.2026 under **Dindigul CWSS** in **Dindigul district**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
16.05.2026	Namakkal	KALAIKATHIR	Frequently broken pipes cause drinking water to flow on the road



160 mm HDPE pipe line leak was rectified and water supply effected on 15.05.2026 under **CWSS to 547 Habitations in Namakkal district**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
16.05.2026	TUTCORIN	DINATHANTHI	Water was wasted on the road due to a broken pipe



63 mm PVC pipe line leak was rectified and water supply effected on 17.05.2026 under 159 CWSS in Tutucorin district

Action taken on the Water supply issues reported


Date	District	Name of the Newspaper	Issues published
18.05.2026	SALEM	DINAKARAN	Drinking water was wasted due to the negligence of officials.



Leak occurred in 200mm Air valve along Avinashi to Tiruppur road was rectified and water supply effected on 17.05.2026 under CWSIS to Tiruppur Corporation, 15 Velampalayam and Nallur Municipalities, Annur, Avinashi and Thirumuranpoondi Town Panchayats and 362 Rural Habitations in Coimbatore and Tirupur Districts

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
18.05.2026	TIRUCHIRAPALLI	DINATHANTHI	Cauvery drinking water gushed 20 feet high due to a burst pipe

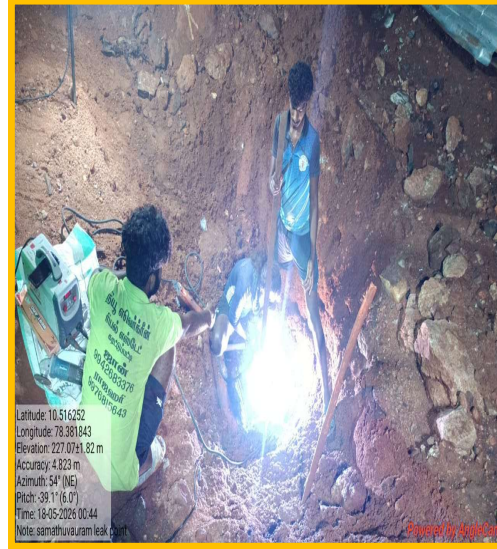

1100 mm MS pipe line leak was rectified and water supply effected on 18.05.2026 under Melur CWSS in Tiruchirapalli district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
19.05.2026	KARUR	DINAKARAN	CWSS pipe broke; causing water wastage



700 mm PSC pipeline leak was rectified and water supply effected on 19.05.2026 under CWSS to 674 habitations in Manappari, Marungapuri Unions and Ponnampatty TP in Trichy District.

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
19.05.2026	TIRUVANNAMALAI	DINAKARAN	Water is being wasted due to a broken CWSS drinking water pipeline



140mm PVC pipe line leak was rectified and water supply effected on 19.05.2026 under CWSS to Chengam,Pudupalayam TPs and 40 wayside habitations in Chengam,Pudupalayam unions in Thiruvannamalai district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
20.05.2026	THIRUVARUR	DINAKARAN	Due to a broken CWSS water pipe; Water is being wasted



1100 mm MS pipe line leak was rectified and water supply effected on 20.05.2026 under Vedaranyam CWSS in Thiruvavur district

Action taken on the Water supply issues reported


Date	District	Name of the Newspaper	Issues published
20.05.2026	RAMANATHAPURAM	DINAMALAR	Water wasted due to broken pipe ; road damaged



200 mm OPVC pipe line leak was rectified and water supply effected on 19.05.2026 under **RAMNAD CWSS in Ramanathapuram district**

Action taken on the Water supply issues reported


Date	District	Name of the Newspaper	Issues published
21.05.2026	PUDUKOTTAI	DINATHANTHI	Water being wasted due to damaged pipe

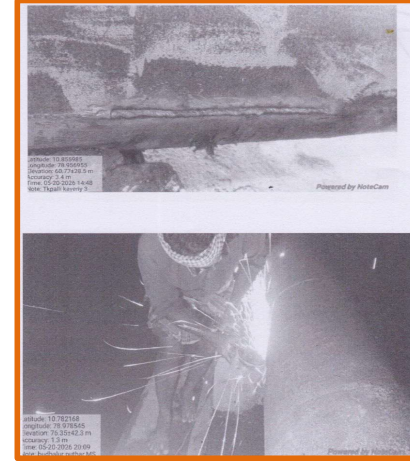

700 mm MS pipe line leak was rectified and water supply effected on 20.05.2026 under CWSS to 706 habitations in Aranthangi, Arimalam, Avudaiyarkovil & Manmelkudi unions in Pudukkottai District

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
22.05.2026	COIMBATORE	DINATHANTHI	Sewage water overflowing through a machinehole

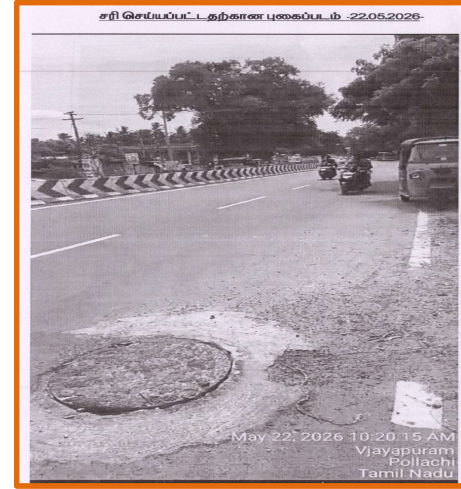

Blockage in machine hole was removed on 22.05.2026 under Pollachi UGSS in Coimbatore district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
23.05.2026	NAMAKKAL	DINATHANTHI	Drinking water pipe damage ; water stag infront of police station



90 mm PVC pipeline leak was attended and water supply effected on 23.05.2026 under CWSS to 90 rural hubs in Kabilarmalai and Paramathi unions in Namakkal district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
23.05.2026	NAGAPATTINAM	DINAKATHIR	Will the Kollidam CWSS pipe rectified ? People worried over the water leak

திட்டச்சேரியில் கொள்ளிடம் கூட்டுக் குடிநீர் குழாயில் உடைப்பு சரி செய்யப்படுமா? தண்ணீர் வீணாக்கி செல்வதால் பொதுமக்கள் வேதனை



திட்டச்சேரியில் கொள்ளிடம் கூட்டுக் குடிநீர் குழாயில் உடைப்பு சரி செய்யப்படுமா? தண்ணீர் வீணாக்கி செல்வதால் பொதுமக்கள் வேதனை தெரிவிக்கின்றனர்.

மமிலாடுதுறைமாவட்டம் கொள்ளிடம் கூட்டு குடிநீர் திட்ட ராட்சத குழாய்கள் மூலம் தண்ணீர் நாகை மாவட்டம் திருமருகல் அருகே தேங்கில் சேகரிக்கப்படுகிறது. இதில் இருந்து ராட்சத குழாய் மூலமாக திட்டச்சேரி, நாகூர், நாகப்பட்டினம், வேளாங்கண்ணி வழியாக வேதாரண்யம் வரை குடிநீர் விநியோகம் செய்யப்பட்டு வருகிறது. திருமருகல் ஓன்றியத்தில் உள்ள ஊராட்சிகளில் குடி தண்ணீர் இதன் மூலமாக தான் வழங்கப்பட்டு வருகிறது. இந்த நிலையில் நாகூர்நன்னிலம் சாலையில் திட்டச்சேரி ஓ.என்.ஜி.சி சாலை அருகில் குடிநீர் குழாயில் பெரிய அளவில் உடைப்பு ஏற்பட்டு உமாதங்கள் ஆகிறது. அதை குடிநீர் வடிகால் வாரிய அதிகாரிகள் இதுவரை சரி செய்யாததால் தினமும் ஆயிரக்கணக்கான லிட்டர் குடிநீர் வீணாகி வாங்க்காலில் செல்கிறது. மேலும் இரவு நேரத்தில் அதிக அழுத்தம் காரணமாக உடைப்பு பகுதியில் இருந்து தண்ணீர் அதிகளவு வெளியேறுவதாக அப்பகுதி மக்கள் கூறுகின்றனர். குழாயில் ஏற்பட்ட உடைப்பு காரணமாக குடிநீர் விநியோகம் பெறும் கிராமங்களில்

குடிநீர் தட்டுப்பாடு நிலவும் அபாயம் உள்ளது. மேலும் வீணாகும் குடிநீர் வாங்க்கால் கரையை அரித்து செல்வதால் சாலையோரம் மண் சரிந்து விபத்துக்கள் ஏற்படும் அபாயம் உள்ளது. இதுகுறித்து சம்பந்தப்பட்ட துறை அதிகாரிகள் பலமுறை புகார் தெரிவித்தும் இதுவரை எந்த வித நடவடிக்கையும் எடுக்கப்படவில்லை என அப்பகுதி மக்கள் வேதனை தெரிவிக்கின்றனர்.


எனவே சம்பந்தப்பட்ட அதிகாரிகள் உடனடியாக ஆய்வு செய்து குழாய் உடைப்பை சரி செய்து குடிநீர் வீணாவதை தடுக்க வேண்டும் என்று அப்பகுதி பொதுமக்கள் கோரிக்கை விடுத்துள்ளனர்.



700 mm DI pipeline leak was attended and water supply effected on 24.05.2026 under CWSS to 980 Habitations in Nagapattinam District

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
24.05.2026	KRISHNAGIRI	KAALAIKATHIR	Hogenakkal water wasted

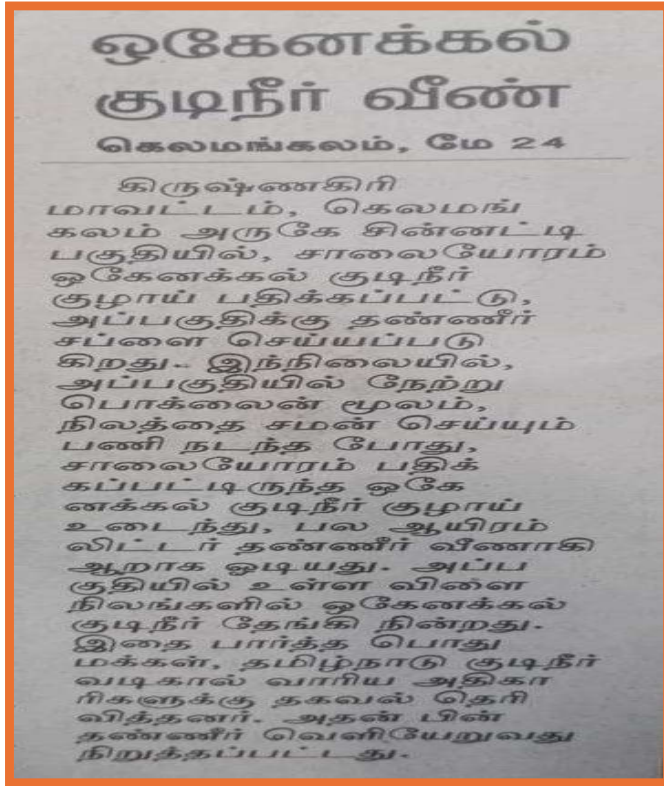

500 mm DI pipeline leak was attended and water supply effected on 24.05.2026 under Hogenakkal Water Supply and Fluorosis Mitigation Project

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
24.05.2026	THANJAVUR	DINATHANTHI	Broken pipe causing water wasted



1100 mm PSC pipeline leak was attended and water supply effected on 30.05.2026 under **Vedaranyam CWSS** in **Thiruvavur district**

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
25.05.2026	MADURAI	DINAMALAR	Drinking water wasted due to broken pipe



140 mm PVC pipeline leak was attended and water supply effected on 25.05.2026 under CWSS to Vadipatty and 7 RHs in Madurai district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
26.05.2026	CHENGALPATTU	DINATHANTHI	People on strike in GST road



600 mm DI pipeline interconnection work was attended and water supply effected on 23.05.2026 under CWSS to Tambaram municipality in Chengalpattu district

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
27.05.2026	RAMANATHAPURAM	DINATHANTHI	Broken pipe causing water leakage



200 mm HDPE pipeline leak was attended and water supply effected on 27.05.2026 under Ramnad CWSS in Ramanathapuram district .

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
28.05.2026	VIRUDHUNAGAR	DINAMALAR	Broken pipe cause water leak



350 mm PSC pipeline leak was attended and water supply effected on 28.05.2026 under CWSS to 161 rural habitations in Kayathar, Ottapidaram & Kovilpatti unions in Thoothukudi district under Kayathar CWSS

Action taken on the Water supply issues reported

Date	District	Name of the Newspaper	Issues published
31.05.2026	KARUR	DINAKARAN	Water wasted due to pipeline leakage near Avarakuruchi



Damaged 450mm DI Pipe leak was rectified and water supply effected on 01.06.2026 under Aravakuruchi CWSS in Karur district